



# PROTOCOL

Test Laboratory No. 1018.3  
accredited according to ČSN EN ISO/IEC 17025 by the Czech Institute for Accreditation

**No. 040-053920**

**on test of sound absorption capacity according to ČSN EN ISO 354:2003**

Client: DROMEAS S.A Papapanagiotou  
Address: Industrial Area of Serres  
Zip Code 62121  
Greece  
Company registration number (VAT): 094 104 476  
Manufacturer: DROMEAS S.A Papapanagiotou  
Address: Industrial Area of Serres  
Zip Code 62121  
Greece  
Test samples: Panel Core 0,65 25mm grey panel with fabric B2L1  
Order: Z040160379

Number of pages including title page: 5

No. of Annexes: 2

Author:

Approved by:

Copy No.:  
No. of copies: 3



Testing laboratory stamp No. 1018.3

  
**Ing. Pavel Rubáš, Ph.D.**  
test technician - specialist

  
**Ing. Pavel Bartoš**  
testing facility deputy manager

Teplice on 20 December 2016

**Declaration:** 1) The test results presented in this Report apply only to the tested object and do not substitute any other documents.  
2) The report may not be reproduced in any other way except in its entirety, without the written approval of the testing laboratory.  
3) Evaluation of the results according to the standards was done above the framework of the activities of an accredited test laboratory

Technický a zkušební ústav stavební Praha, s. p., Centrální laboratoř České Budějovice

Teplice Testing Facility

Tolstého 447, 415 03 Teplice  
931/0100

Phone: +420 417 719 017

Bank details: Komerční banka, Praha 1

www.tzus.eu

e-mail: bartos@tzus.cz

Account No.: 1501-

Registered in the Commercial Register administered by the Municipal Court in Prague, section ALX, file 711,  
company identification No.: 00015679, Tax ID No.: CZ00015679

## 1. General

Based on Order testing was done of the sound absorptivity of panels 2000X1500X25 MM Panel Core 0,65 25mm grey panel with fabric B2L1 which was supplied by the manufacturer DROMEAS S.A Papapanagiotou to the extent according paragraph 3 of this protocol.

## 2. Test sample

The test sample was applied by the TZÚS Praha, s.p. on 15/12/2016 and in Test Laboratory No. 1018.3 was recorded on 15/12/2016 under record number:

Sample	Laboratory Record Number	Declared th.
Panel Core 0,65 25mm grey panel with fabric B2L1	VZ040163190/3	25 mm

## 3. Tests done

Date of installation of the samples: 15/12/2016

Testing date: 15/12/2016

The test has been carried out by: Lukáš Rulf

Tests Performed (general simplified name):

- determination of sound absorption capacity according to ČSN EN ISO 354:2003

### Data declared by the manufacturer:

Panel Core 0,65 25mm grey panel with fabric B2L1

### Preparation of samples and method of installation:

The sample was visually inspected upon acceptance, and its type checked according to the specification. The samples complied with the specification. The installation was done by the staff of TZÚS Praha, s.p.; the sample was applied to the rear section of the floor of chamber D1.

Data on sample composition were taken from the specification provided by the manufacturer. The mentioned technical parameters are intended for inspection and documentary purposes and are only informative in character.

### Test reverberation rooms:

D1 (reverberation chamber TZÚS 2015)

### Technical specification of the test:

Measurement was done in an anechoic chamber according to ČSN EN ISO 354. Measurement is done by omnidirectional impact of the sound waves on the sample and is based on measurement of the reverberation time of the empty chamber and the chamber containing the tested sample. The difference in measurements is used to specify the equivalent absorption area of the sample and the sound absorption coefficient  $\alpha_s$ . The measurement was done in one third octave bands from 100 to 5000 Hz.

The results of the test are the values of sound absorption coefficient  $\alpha_{si}$  in one third octave bands from 100 to 5000 Hz. The main result of testing that is objectively related to the tested structure is the **single digit variable of the weighted sound absorption  $\alpha_w$** .



The average reverberation time in the reverberant chamber is determined by measurement with a test sample installed and without a test sample. The equivalent absorption area  $A_1$ , in square metres, of an empty reverberant chamber is calculated using the formula:

$$A_1 = \frac{55,3V}{cT_1} - 4Vm_1$$

Where

- V is the volume of the empty reverberant chamber in cubic metres;
- c speed of sound transmission in the air in metres per second (for the usual laboratory temperatures in the range  $t = 15\text{ °C}$  to  $30\text{ °C}$ , the value is calculated as  $c = 331 + 0.6t$  (m/s);
- $T_1$  reverberation time, in seconds, of an empty reverberant chamber;
- $m_1$  attenuation coefficient in air, in  $\text{m}^{-1}$ , calculated according to ISO 9613-1 with respect to climatic conditions that existed in the empty reverberant chamber during measurement.

Value  $m_1$  can be calculated from the damping factor  $\alpha$ , which is used in ISO 9613-1, according to the formula:

$$m = \frac{\alpha}{10 \lg(e)}$$

The equivalent absorption area  $A_2$ , in square metres, of the reverberant chamber containing a test sample is calculated using the formula:

$$A_2 = \frac{55,3V}{cT_2} - 4Vm_2$$

Where

V and c have the same meaning as in the previous paragraph;

- $T_1$  reverberation time, in seconds, of the reverberant chamber after the test sample has been placed;
- $m_2$  attenuation coefficient in air, in  $\text{m}^{-1}$ , calculated according to ISO 9613-1 with respect to climatic conditions that existed in the reverberant chamber including the sample.

The equivalent absorption area A, in square metres, is calculated using the formula:

$$A_T = A_2 - A_1 = 55,3V \left( \frac{1}{c_2 T_2} - \frac{1}{c_1 T_1} \right) - 4V(m_2 - m_1)$$





Where

$c_1$  is the speed of sound propagation in air at temperature  $t_1$ ;  
 $c_2$  for speed of sound propagation in air at temperature  $t_2$ ;  
 $A_1, V, T_1, m_1, A_2, T_2$  and  $m_2$  have the same meaning as in previous paragraphs.

The sound absorption coefficient  $\alpha$  of the sample is calculated using the formula:

$$\alpha_s = \frac{A_T}{S}$$

Where

$A_T$  is the equivalent absorption area  $A$ , in square metres  
 $S$  is the area covered by the test sample in square metres

#### 4. Standards applied

##### 4.1 Testing standards

ČSN EN ISO 354:2003 Acoustics - Measurement of sound absorption in a  
reverberation room

##### 4.2 Referenced standards

ČSN EN ISO 11654:1998 Acoustics - Sound absorbers for buildings - Assessment of  
sound absorption  
VDI 3755:2015-01 Sound insulation and sound absorption

#### 5. Measuring and other instruments used

- Norsonic type 118 – Integration sound-level meter of accuracy 1 complying with EC 60651, 60804, 61672-1, and 61260, primary memory for 2,500,000 data items. Serial number 31991, 8012-OL-10125-16 valid until: 28/03/2018
- Microphone Norsonic type 1225 and pre-amp type 1205, serial No. 72839, test sheet No. ... test sheet: 8012-OL-10128-16 valid until: 28/03/2018
- Norsonic acoustic calibrator, type 1251, serial No.: 31612. The meter complies with the requirements of the IEC 942, 8012-KL-10129-16 standard, valid until: 23/03/2018
- Thermometer and Hygrometer Testo 608-H1, serial number 445815, calibration certificate KLT-10K-886 effective until 7 November 2017.
- Digital barometer VOLTCRAFT DL180-THP, serial number 10052467, calibration certificate 1485/11 effective until 28 June 2017.
- Sound field excitation set, Norsonic hemisphere, type 250 (120 dB).

Instruments and measuring devices are validated according to the applicable metrological plan of the Teplice Test Facility.



## 6. Test results

The test results are given in the annexes, applicable single-digit values and descriptions are given in table 1.

TABLE 1a Single-digit value and class according to ČSN EN ISO 11654:1998:

Property	Units	Class	Weighted sound absorption $\alpha_w$ . Verbal description VDI 3755:2015- 01
Panel Core 0,65 25mm grey panel with fabric B2L1 VZ040163190/3	---	C	0.65 (LH) Highly absorptive

**END OF THE REPORT**



## Sound absorption coefficient according to ISO 11654

Measurement of sound absorption coefficient in a reverberation room


Client: DROMEAS S.A Papapanagiotou, Industrial Area of Serres, Zip Code 62121, Greece  
Description: Panel Core 0,65 25mm grey panel VZ040163190/3 25 mm with fabric B2L1

Date of test: 15.12.2016

Object: VZ040163190/3

Surface area:	12,00 m <sup>2</sup>	Empty reverberation room:	Relative humidity:	51,1 %	Reverberation room with object:	Relative humidity:	56,7 %
Reverberation room volume:	206,2 m <sup>3</sup>		Temperature:	10,6 °C		Temperature:	8,5 °C
			Barometric Pressure:	994 kPa		Barometric Pressure:	1004 kPa

Frequency f [Hz]	$\alpha_p$
125	0,35
250	0,70
500	0,55
1000	0,70
2000	0,95
4000	1,00

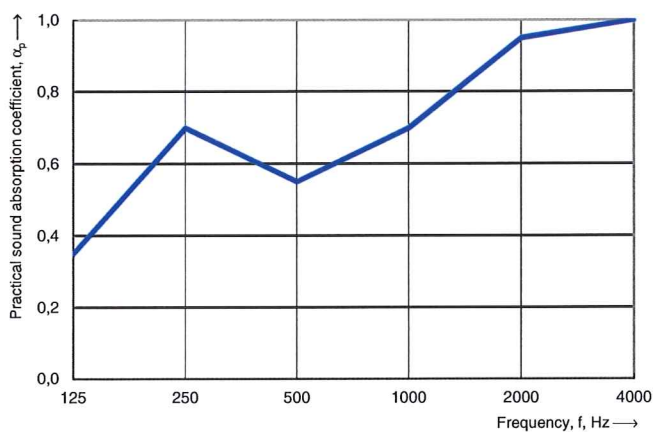

Weighted sound absorption coefficient according to ISO 11654

$\alpha_w = 0,65$  (LH)

No. of test report: Annex no. 1, Protocol no. 040-053920



**Evaluation according to EN ISO 11654****Acoustics - Sound absorbers for use in buildings - Rating of sound absorption and VDI 3755/2000**

Sample	$\alpha_w$	Class ČSN EN ISO 11654 --- VDI 3755/2000
Panel Core 0,65 25mm grey panel with fabric B2L1	<b>0,65 (LH)</b>	<b>C</b> --- <b>high absorptive</b>

Tab. 1 -  $\alpha_w$  evaluation

Class	$\alpha_w$	Description
EN ISO 11654		VDI 3755/2000
A	0,90; 0,95; 1,00	very high absorptive
B	0,80; 0,85	very high absorptive
C	<b>0,60; 0,65; 0,70; 0,75</b>	<b>high absorptive</b>
D	0,30; 0,35; 0,40;	absorptive
	0,45; 0,50; 0,55	
E	0,15; 0,20; 0,25	low absorptive
---	0,05; 0,10	reflective

